

Mechanical Testing

- 
- Anchorages
 - Bending
 - Calibration
 - Compression
 - Concrete
 - Covers and Grates
 - Fasteners
 - Fatigue
 - Formwork
 - Jacks and Stands
 - Lifting Devices
 - Proof Load
 - Reinforcing Products
 - Scaffolding
 - Structures
 - Tensile

IN CONFIDENCE TO THE CLIENT

REPORT NO: MT-17/893-B

LOAD TESTING OF A 14" PERPENDICULAR POOL GRATE FOR CLASS A

CLIENT: **DALDORADO**
 ATTENTION: ROBERT LAWSON
 5/99 HUMPHRIES ROAD
 FRANKSTON SOUTH VIC 3199

DATE OF TEST: OCTOBER 3RD TO OCTOBER 4TH 2017

DATE OF REPORT: OCTOBER 13TH 2017

TEST SYNOPSIS:

Interlocking modular pool grate members were delivered to the MTS laboratory for load testing (see Fig. 1). At the request of the client, DALDORADO, the components were to be assembled to a 12" length and Type Tested for **Class A** in accordance with AS 3996 — 2006 ACCESS COVERS AND GRATES; CLAUSE 4.2.1.2 and APPENDIX C. Following testing to AS 3996, the assembly was to be loaded until failure in order to determine the ultimate strength capacity of the specimen.

Upon arrival at the laboratory the following details and nominal dimensions were recorded:



FIG. 1
'PERPENDICULAR' POOL GRATE
COMPONENTS AS DELIVERED

<i>Specimen I.D.:</i>	'Perpendicular' Grate
<i>Grate Width:</i>	355.6 mm (14")
<i>Assembled Length:</i>	304.8 mm (12")
<i>Material:</i>	PVC
<i>Module Members:</i>	355.6 × 38 × 12 mm sections
<i>Module Spacing:</i>	20 mm centres
<i>Module Connectors:</i>	Two (2), Ø10 mm socket/spigot pairs per member at 115 mm centres
<i>Circular Opening (CO):</i>	292 mm

TEST PROCEDURE:

The assembled access cover grate was aligned centrally under the actuator of a calibrated universal testing machine (UTM). The specimen was rigidly supported on two (2) parallel edges with a free span of 292 mm to replicate the bearing conditions typically seen in service (see Fig. 2). A series of displacement transducers was used to measure the net deflection at the centre of the cover throughout testing. All compressive test loads were applied vertically to the centre of the cover grate via a 240 × 240 mm square loading platen. Test load and deflection were recorded autographically during testing using a computerised data acquisition system.

Serviceability Design Load

Serviceability Design Load (SDL) testing was conducted in accordance with AS 3996 CLAUSE C4.5 and C4.6. Prior to testing, the displacement transducers were balanced to establish a deflection datum. Test load was applied at a rate of 1 kN/s until the SDL of **6.7 kN** was achieved, as specified by TABLE 3.1 of AS 3996 for Class A grates. After maintaining the SDL for five (5) seconds, the change in deflection at the centre of the test cover was recorded and the test force removed. Following removal of the SDL, any permanent deformation of the grate was logged. This process was repeated a total of five (5) times as per the requirements of AS 3996 – 2006 CLAUSE C4.3.



**FIG. 2
GRATE TEST SET-UP**

Ultimate Limit State

The Ultimate Limit State (ULS) test immediately followed completion of the SDL test and was conducted in accordance with AS 3996 – 2006 CLAUSE C4.7. The ULS load of **10 kN**, as specified by TABLE 3.1 of AS 3996 – 2006 for Class A covers, was applied at a constant rate of 1 kN/s to the centre of the cover and held for a period of 30 seconds. The test load was then removed and the grate was inspected for visible signs of cracking, collapse or other similar forms of structural failure.

Ultimate Strength Capacity

Upon complete of the AS 3996 load tests, the access grate was reinstalled centrally in a UTM. Compressive test force was then gradually applied to the specimen until a peak load was achieved and a mode of failure was evident.

TEST OBSERVATIONS:

Serviceability Design Load

During the initial SDL application of 6.7 kN, the loaded net deflection was recorded to be **2.2 mm** at the centre of the grate which is less than the maximum allowable deflection of 6.5 mm, as required by TABLE 4.2 of AS 3996 – 2006 for a Class A access cover grate with a circular opening of 292 mm.

Upon conclusion of the SDL test, the net permanent set at the centre of the grate was recorded to be **0.0 mm** which is less than the maximum allowable permanent set of 2.9 mm, as required by TABLE 4.2 of AS 3996 – 2006 for a Class A access cover grate with a circular opening of 292 mm.

Ultimate Limit State


The tested pool grate was observed to sustain the ULS load of 10 kN for 30 seconds without visible signs of cracking, collapse or other structural failure.

Ultimate Strength Capacity

The grate achieved a peak load of 27.7 kN. Upon attaining this load, the outer modular members of the specimen separated, resulting in a corresponding abrupt reduction in load carrying capacity.

TEST DATA:

Test curves for the Serviceability Design Load and Ultimate Limit State are provided in Figure 3.

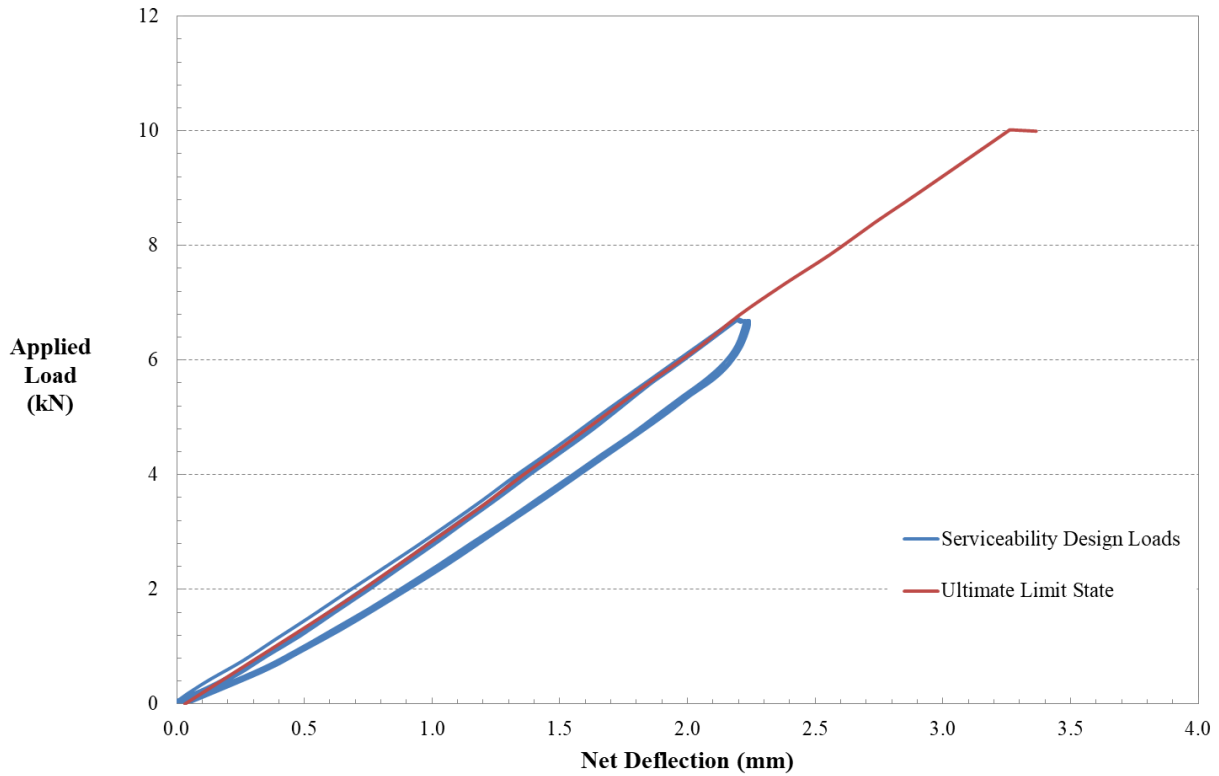

**FIG. 3
TEST CURVES**

SUMMARY

The DALDORADO 14” wide ‘Perpendicular’ pool grate, as tested and reported herein, is compliant to the Type Test requirements as specified in AS 3996 – 2006 CLAUSE 4.2.1.2 for a Class A cover with a circular opening of 292 mm.

NOTES:

1. Melbourne Testing Services (MTS) Pty Ltd shall not be liable for loss, cost, damages or expenses incurred by the client or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Melbourne Testing Services Pty Ltd be liable for consequential damages including, but not limited to, lost profit, damages for failure to meet deadlines and lost production arising from this report. This document shall not be reproduced except in full and relates only to the items tested.
2. It remains the responsibility of the client to ensure that the samples tested are representative of the entire product batch.
3. MTS shall take no responsibility for the procurement and authenticity of the test product as described herein.
4. This report is specific to the test items in their state at the time of testing. It should not be taken as a statement that all products in all states of repair, would also perform in the same manner.
5. Testing of the cover/grate as reported herein is strictly conditional on the cover/grate being fully rigidly supported. MTS shall therefore take no responsibility for the performance of cover/grate supported in conditions other than those as outlined herein.
6. MTS shall take no responsibility for the assembly procedures or installation used for the test items as described herein.

GAVIN VAN DEVENTER
AUTHORISED SIGNATORY

BRENDAN LEIS
TEST ENGINEER

